



Village of Hinsdale
19 E. Chicago Avenue
Hinsdale, IL 60521-3489
(630)789-7000

Village Website: www.villageofhinsdale.org

PUBLIC SERVICES UTILITY PERMIT APPLICATION

Date of Application: 2/04/2021 Permit No: COMED-0036 Permit Expiration Date: 12-31-2021

Utility Company Information:

Company Name: ComEd
Address: One Lincoln Centre 6th Floor
City, State, Zip: Oakbrook Terrace, IL 60181
Contact Person: Sandi Burton
Phone Number: 312-763-2198
Email Address: sburton@kdmengineering.com
Cell Number: 847-961-0623
Project/Work Order Number: WO16382727 5P205645

Contractor Information:

Company Name: Same as Utility Company
Address: _____
City, State, Zip: _____
Contact Person: _____
Phone Number: _____
Email Address: _____
Cell Number: _____

PROJECT LOCATION: 501 Ogden Ave, Hinsdale

Description of work covered under this permit: Aerial utility pole work at Location 4 (please see attached design)

Start Date: 04/01/2021

Completion Date: 11/01/2021

Site Plan/Details/Specifications (3 sets) included with application?

☒ YES

☐ NO

Certificate of Insurance included with application?

☐ YES

☒ NO

Type of Utility:

☒ ComEd

☐ Nicor

☐ Comcast

☐ Water

☐ Sewer

☐ Communications:

☐ Fiber Optic

☐ Wireless

☐ Other:

Applicant Information:

Print Name: Sandi Burton

Phone Number: 847-961-0623

Company: ComEd

Email Address: sburton@kdmengineering.com

Signature: Sandra J Burton

Digitally signed by Sandra J Burton
Date: 2021.02.04 15:31:27 -06'00'

Date: 2/04/2021

ALL CONSTRUCTION SHALL BE DONE IN ACCORDANCE WITH THE LATEST EDITION IN EFFECT ON THE DATE OF PERMIT APPLICATION OF THE FOLLOWING: STANDARD SPECIFICATIONS FOR ROAD AND BRIDGE CONSTRUCTION & SUPPLEMENTAL SPECIFICATIONS AND RECURRING SPECIAL PROVISIONS BY THE ILLINOIS DEPARTMENT OF TRANSPORTATION, ILLINOIS MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES FOR STREETS AND HIGHWAYS, STANDARD SPECIFICATIONS FOR WATER AND SEWER MAIN CONSTRUCTION IN ILLINOIS, AND THE VILLAGE OF HINSDALE SUBDIVISION ORDINANCE AND ENGINEERING STANDARDS.


Village Use Only


Permit Approved: YES NO

Conditions for Approval/Reasons for Denial: RESTORE ALL DISTURBED AREAS WITHIN 14 DAYS OF COMPLETION. NOTIFY BUSINESSES AND RESIDENTS 48 HRS PRIOR TO START.

Approved By: A. Diaz

Date: 02-08-21

Permit Type	Project Name	Office	Designer	Location - Reason For Work	Work Order #
CITY, COUNTY, IDOT	0000294262	GLENBARD	STANCIL WOOD, KDM	VARIOUS	16382727
Permit Number	SR #	JWA #	Phone #	FEJA PD 5P205645 VOLTAGE OPTIMIZATION CIRC W6610X	Schedule Group
PENDING	NA	1063382	773-612-1117		
Joint Work Contact	SER / CWA #	Phone RO #	PD #	Town or Township	OS / Block
NA	NA	NA	5P205645	OAKBROOK, HINSDALE	VARIOUS
Date Issued: 01/13/2021 IFC REV0		Contingent WO #s	NA	Completed By :	Date :
		Page 1 of 4		Verified By :	Date :

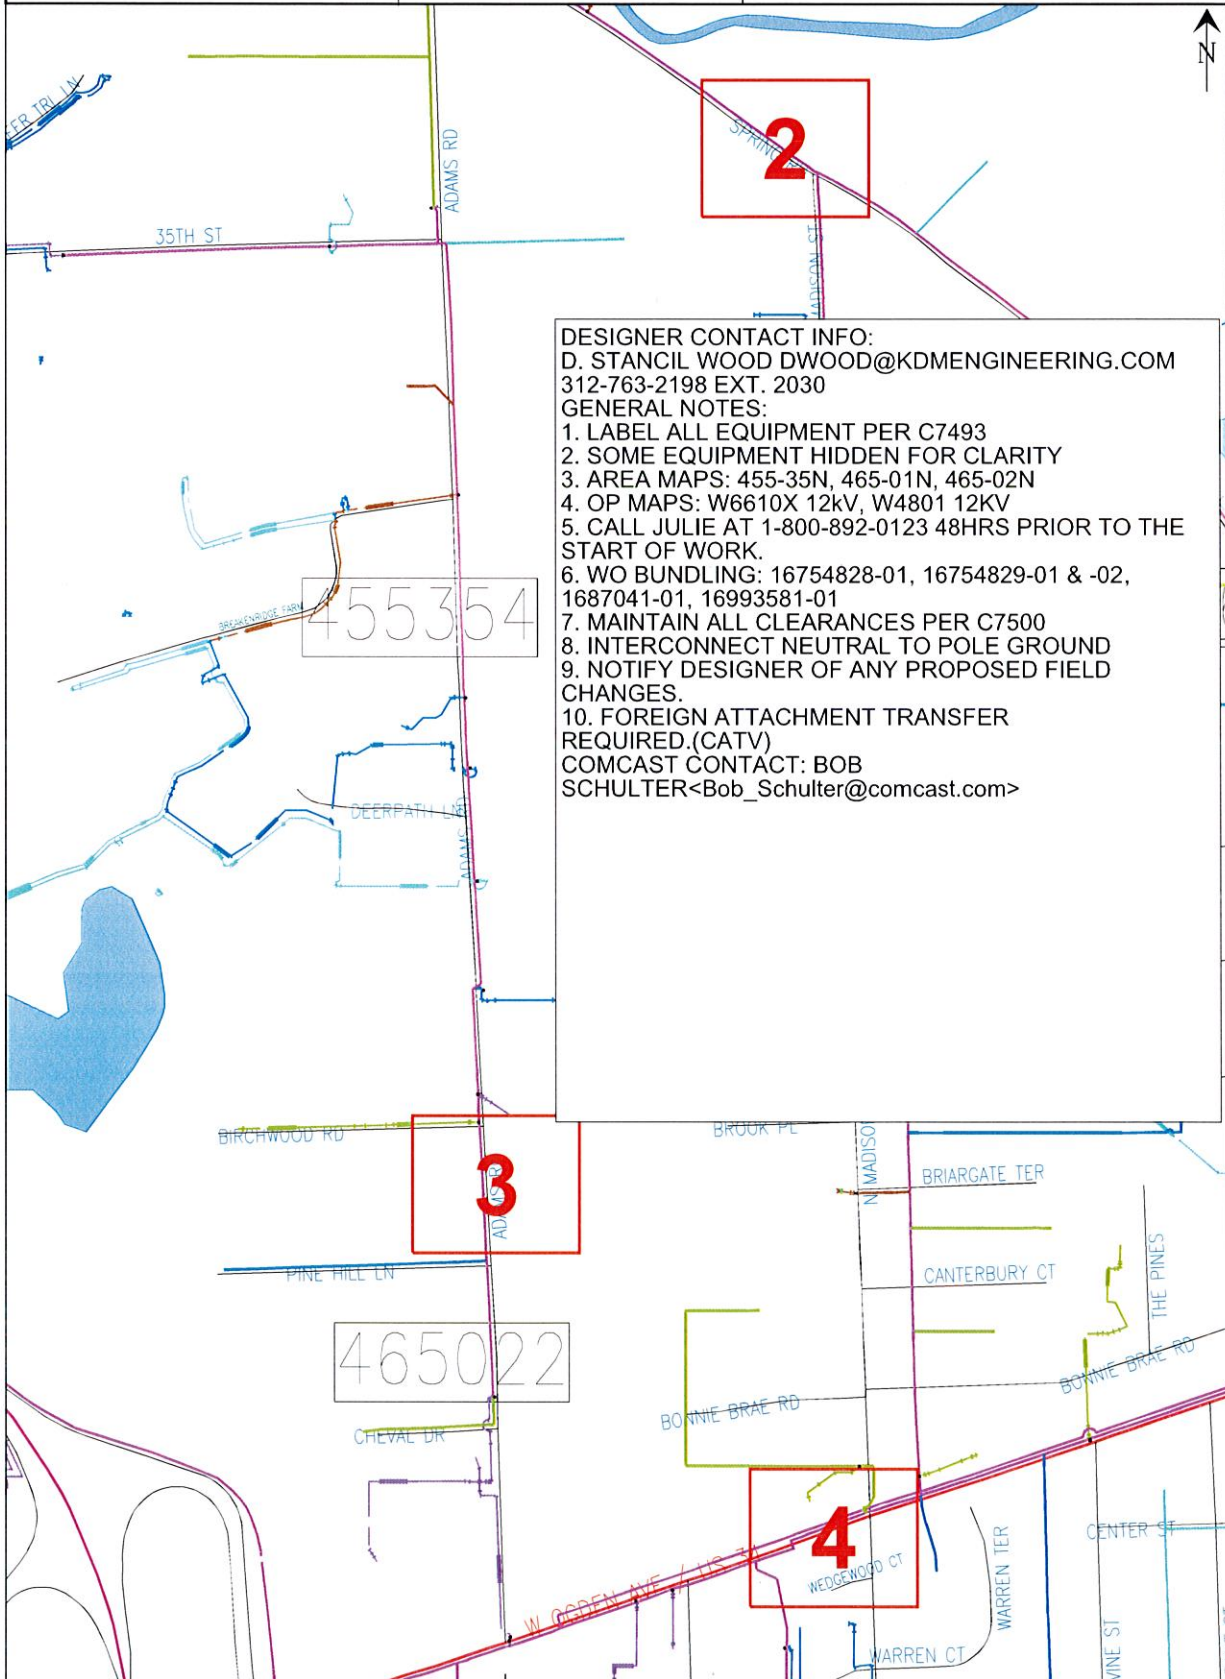


Permit Type	Project Name	Office	Designer	Location - Reason For Work	Work Order #
CITY, IDOT	0000294262	GLENBARD	STANCIL WOOD, KDM	OGDEN AVE & MADISON ST	16382727
Permit Number	SR #	JWA #	Phone #	FEJA PD SP205645 VOLTAGE OPTIMIZATION CIRC	Schedule Group
PENDING	NA	1063382	773-612-1117	W6610X	
Joint Work Contact	SER/CWA #	Phone RO #	PD #	Town or Township	QS/Block
NA	NA	NA	SP205645	HINSDALE	465022
Date Issued: 01/13/2021 IFC REV0	Contingent WO #s	NA	Completed By:	Date:	
0.0	57.0	114.0 FT	Page 4 of 4	Verified By:	Date:

FEJA PD 5P205645 VOLTAGE OPTIMIZATION CIRC W6610X
FEEDER: W6610X PG 6 OF 6, W4801 PG 2 OF 2
AREA MAP: 465-02N, 465-01N


4. AT POLE 465022067
REMOVE 600KVAR CAPACITOR BANK, TRANSFORMER, CONTROLLER, CUTOUPS, FUSES, GROUND, AND ARRESTERS.
INSTALL 600 KVAR 3-PHASE CAPACITOR BANK PER C8262.ABCA, FUSES PER C8607.H & C8600.AAS, ARRESTER PER C8505.F1, RADIO & ANTENNA PER C9925.BD, GROUND PER C8550.AAE, GROUND PROTECTION PER C8551.A, AND WILDLIFE PROTECTION PER C7511.Q, MOUNT BOTTOM OF CONTROL CABINET 11' ABOVE GRADE. PROGRAM CAPACITOR BANK PER SETTINGS BELOW.

Capacitor Settings/Info	600 KVAR Cap Bank# 2
Fault Current (AMPS)	3,658
Season#1	May1-Sep30
Set up:	Voltage Controlled, Normally ON
Time Turn On/Turn Off:	N/A
Days of the week:	N/A
Voltage override turn On:	118V (on 120V scale)
Voltage override turn Off:	126V (on 120V scale)
Season#2	Oct 1 to Apr 30
Set up:	Voltage Controlled, Normally OFF
Time Turn On/Turn Off:	N/A
Days of the week:	N/A
Voltage override turn On:	118V (on 120V scale)
Voltage override turn Off:	126V (on 120V scale)
Holidays:	Off Holidays

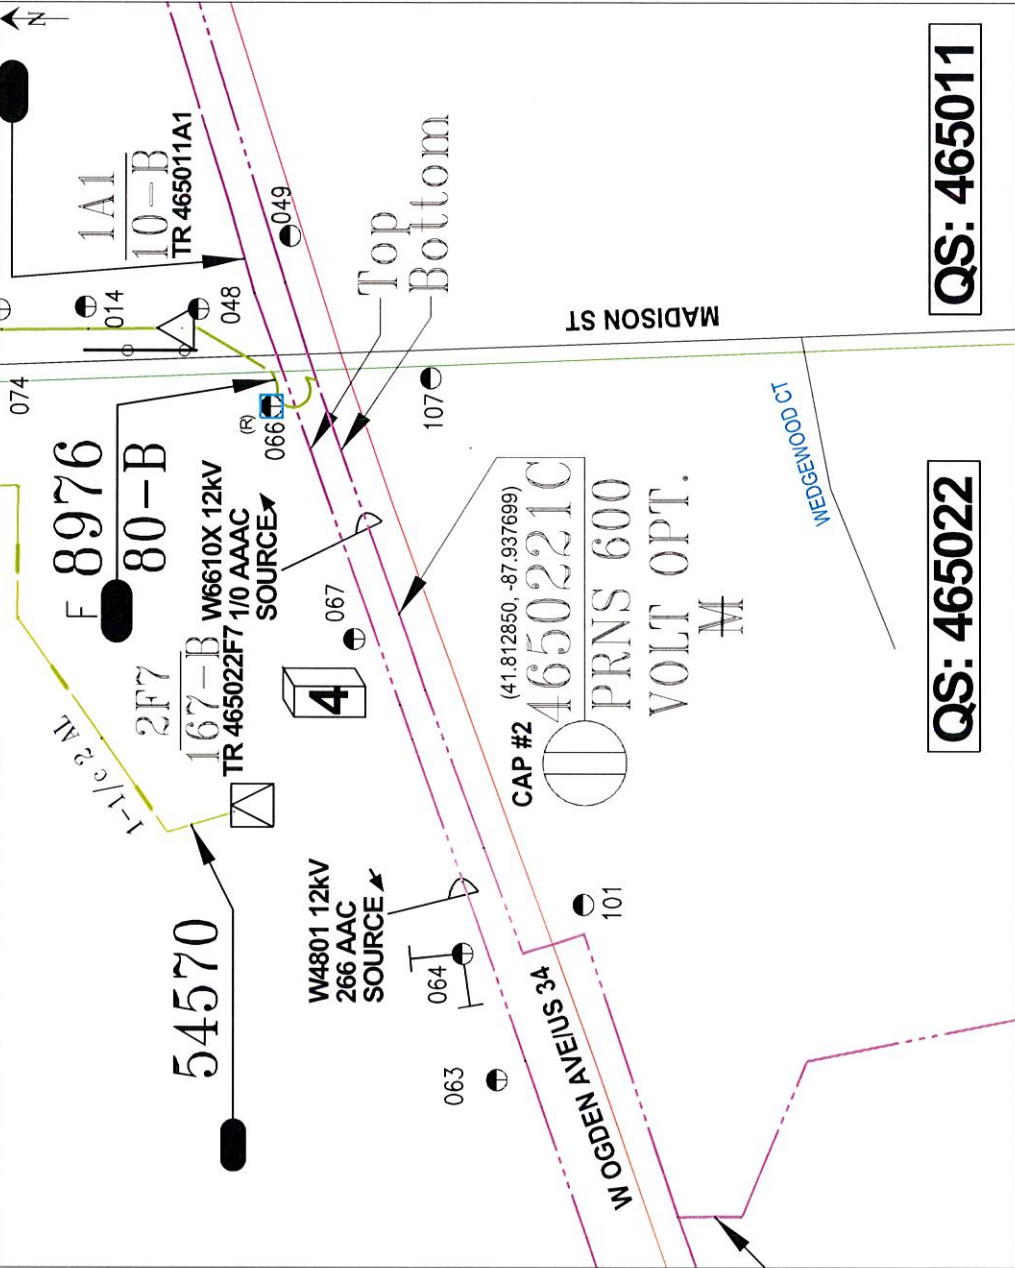

QS: 465011

QS: 465022

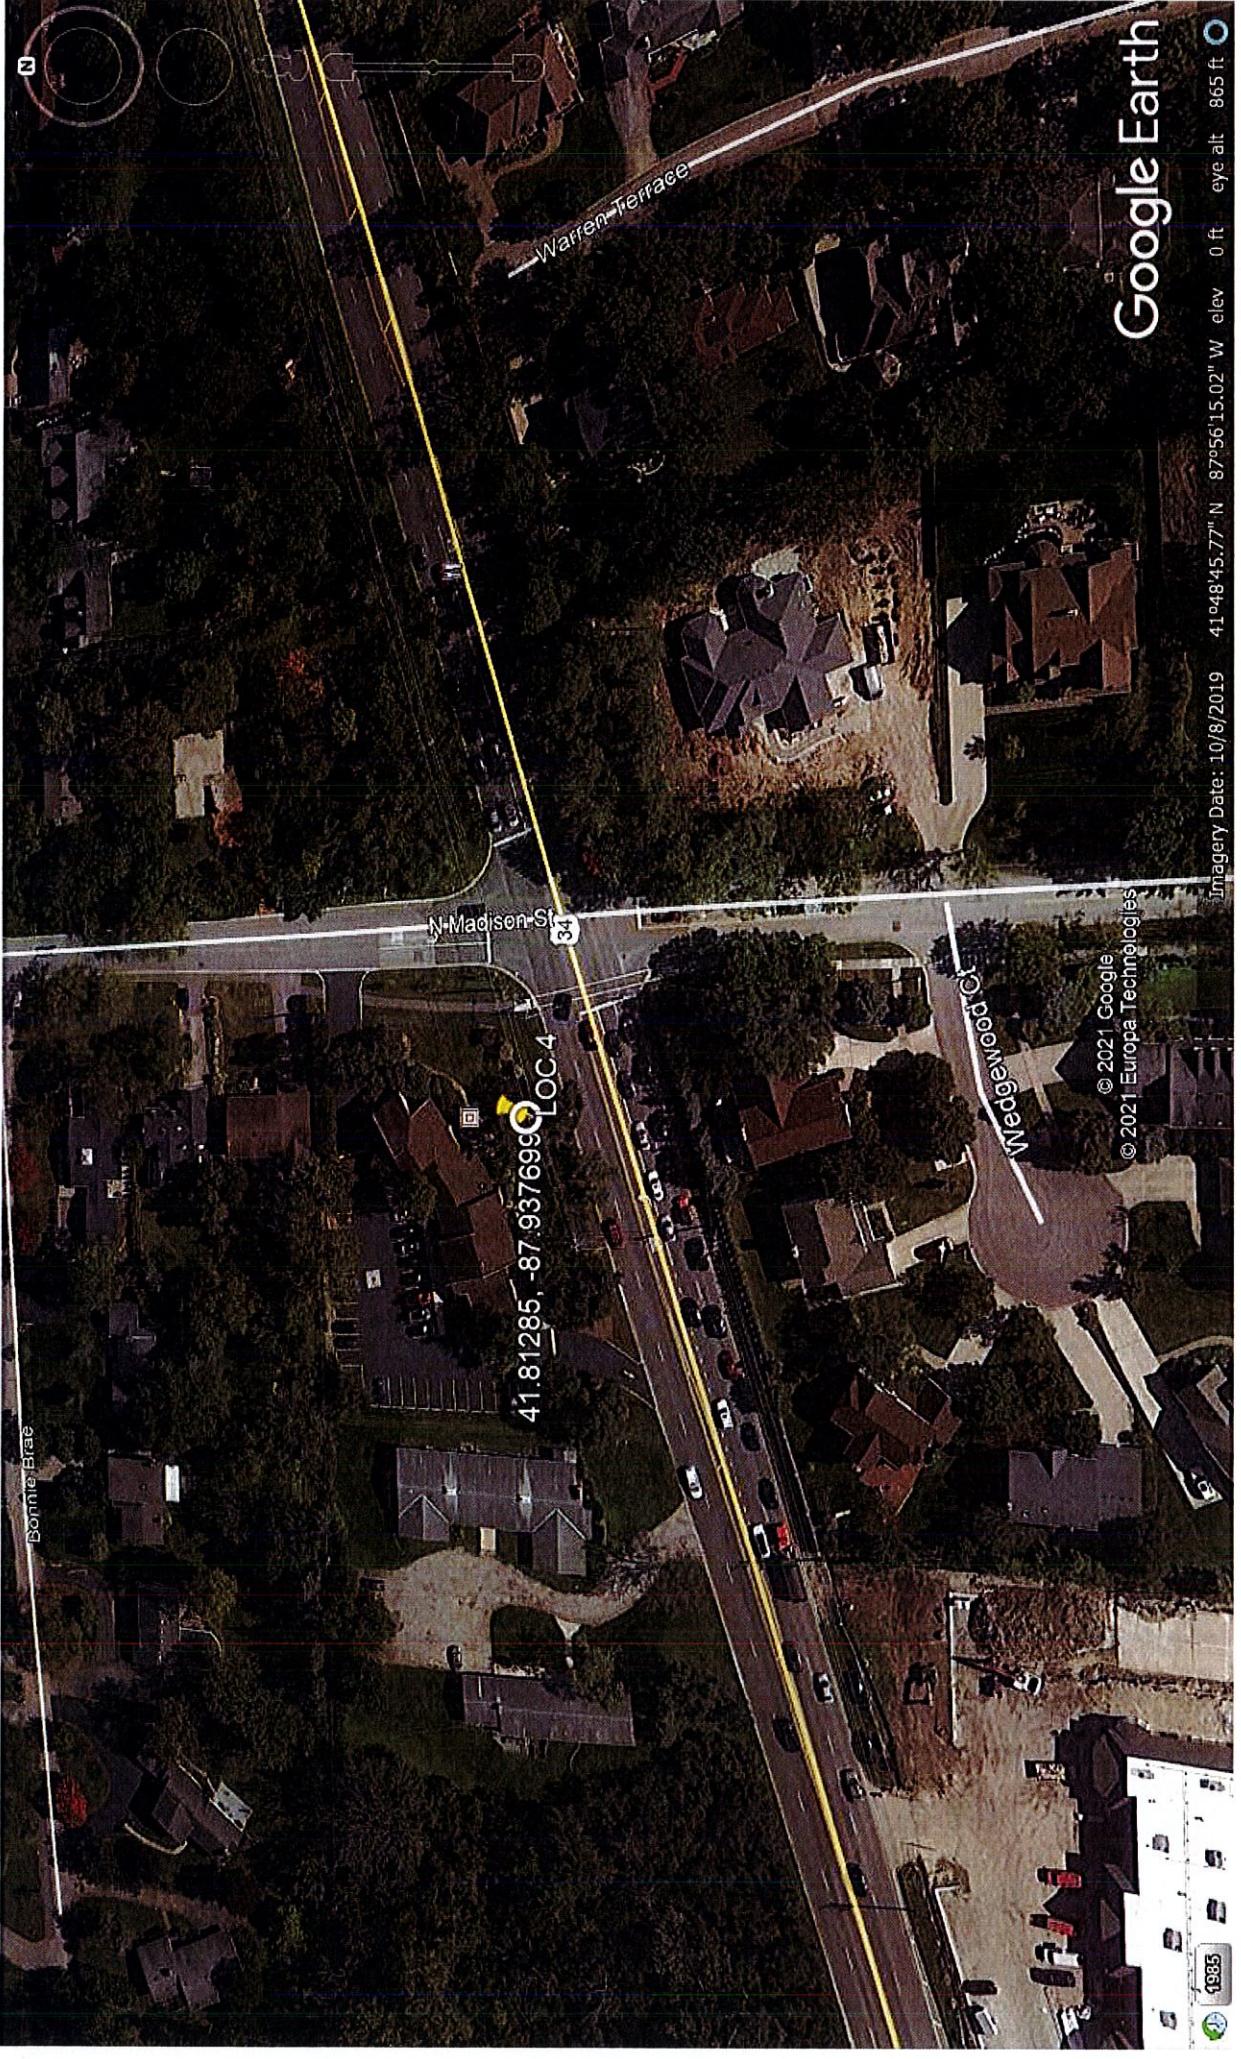

Donnie Brae

Warren Terrace

Wedgewood Ct

N Madison St

41.81285, -87.937699 LOC 4

Google Earth

© 2021 Google
© 2021 Europa Technologies

Imagery Date: 10/8/2019 41°48'45.77" N 87°56'15.02" W elev 0 ft eye alt 865 ft

