GODFREY HOFFMAN ASSOCIATES, LLC
PROFESSIONAL LAND SURVEYORS & CIVIL ENGINEERS

Stormwater Management Narrative
Premier Car Center
384 State Street
August 7, 2020

The applicant is proposing to install a new self-service vacuum area consisting of four (4) vehicle spaces. The self-serve vacuums will be in a newly constructed paved area adjacent to the entrance to the car wash facility. In order to accommodate the new impervious pavement area, sub-surface stormwater chambers will be installed sized for 1" of runoff from the new paved area. Runoff will be collected within a yard drain and conveyed to the chambers.

Impervious Area = 1,360 sf

Volume of 1" of Rainfall = (1/12) (1360) = 113.3 cf

Install 3 – CULTEC Recharger 150 XLHD Stormwater Chambers providing 50.17 cf//unit installed storage.

Total storage volume = 3 x 50.17 = 150.5 cf

MAIN OFFICE: 26 Broadway North Haven, CT 06473 Phone: 203.239.4217 Fax: 203.234.2088
FARMINGTON OFFICE: 1783 Farmington Ave, Unionville, CT 06085 Phone 860.673.0444 Fax: 860.675.7429
www.godfreyhoffman.com

Plan View Drawing

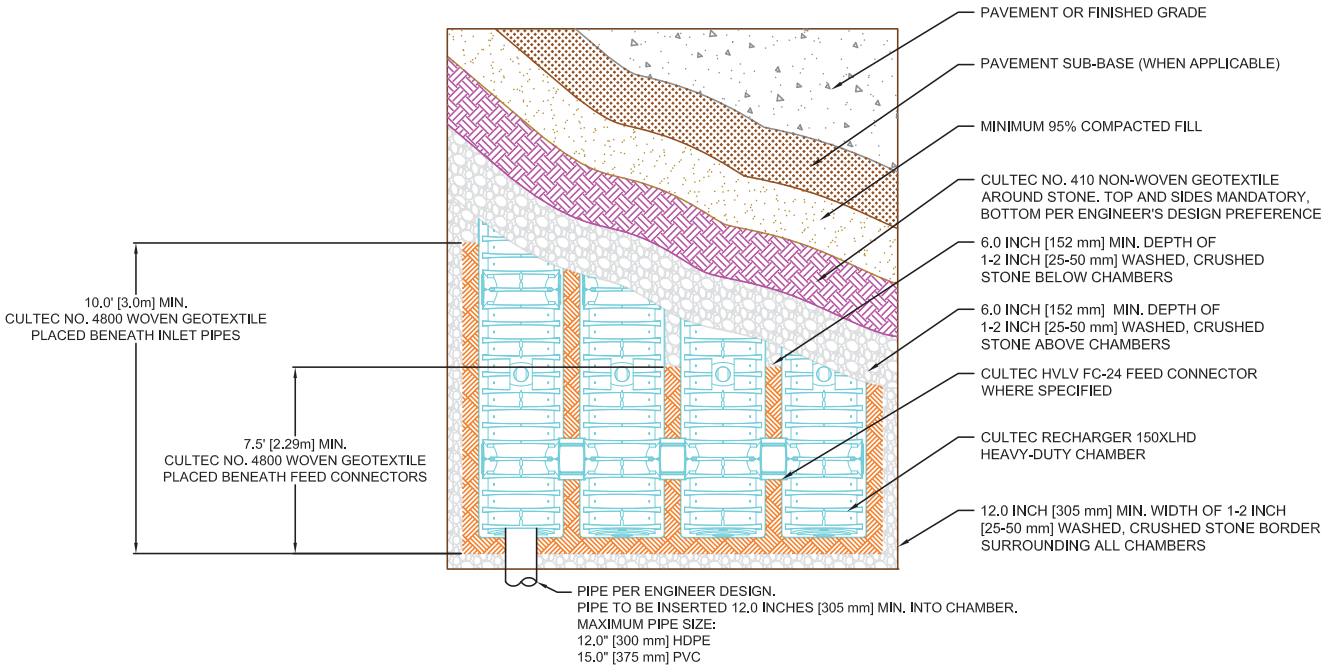

Typical Cross Section for Traffic Application

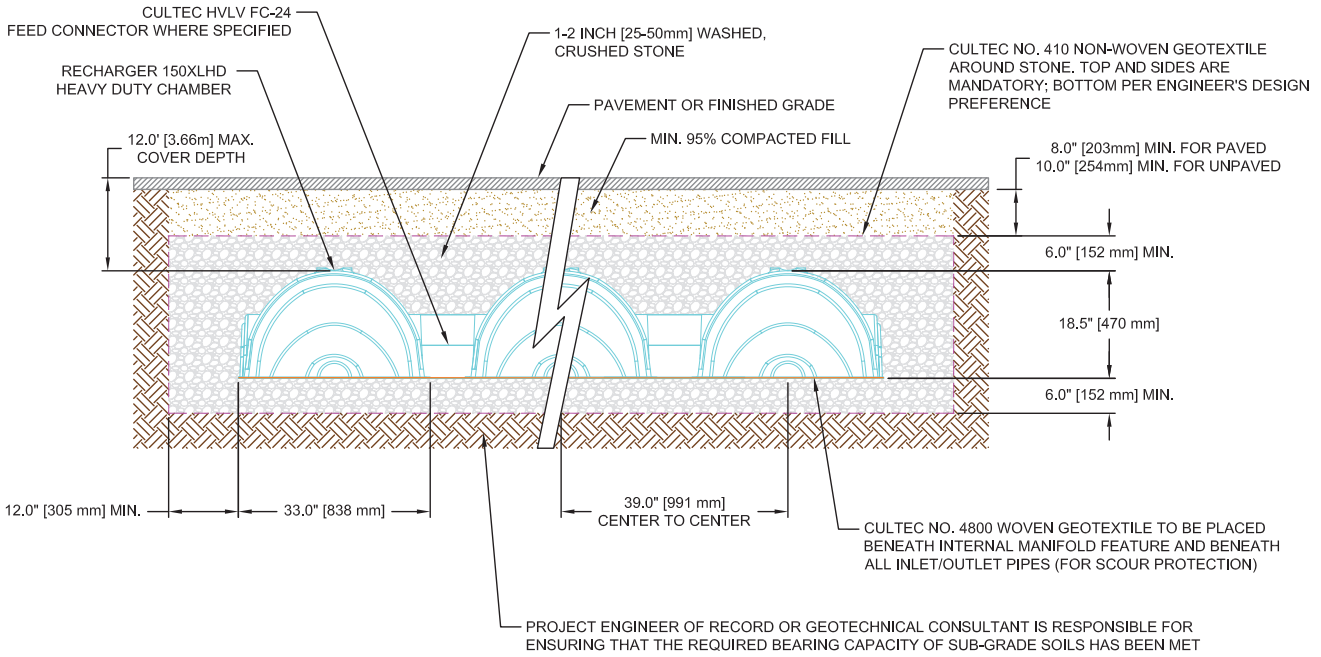

CULTEC Recharger® 150XLHD Specifications

GENERAL

CULTEC Recharger® 150XLHD chambers are designed for underground stormwater management. The chambers may be used for retention, recharging, detention or controlling the flow of on-site stormwater runoff.

CHAMBER PARAMETERS

1. The chambers shall be manufactured in the U.S.A. by CULTEC, Inc. of Brookfield, CT (cultec.com, 203-775-4416).
2. The chamber shall be vacuum thermoformed of polyethylene with a black interior and blue exterior.
3. The chamber shall be arched in shape.
4. The chamber shall be open-bottomed.
5. The chamber shall be joined using an interlocking overlapping rib method. Connections must be fully shouldered overlapping ribs, having no separate couplings or separate end walls.
6. The nominal chamber dimensions of the CULTEC Recharger® 150XLHD shall be 18.5 inches (470 mm) tall, 33 inches (838 mm) wide and 11 feet (3.35 m) long. The installed length of a joined Recharger® 150XLHD shall be 10.25 feet (3.12 m).
7. Maximum inlet opening on the chamber end wall is 12 inches (300 mm) HDPE and 15 inches (375 mm) PVC.
8. The chamber shall have two side portals to accept CULTEC HVLV® FC-24 Feed Connectors to create an internal manifold. The nominal I.D. dimensions of each side portal shall be 8.5 inches (216 mm) high by 12 inches (304 mm) wide. Maximum allowable O.D. in the side portal is 10 inches (250 mm) HDPE, PVC.
9. The nominal chamber dimensions of the CULTEC HVLV® FC-24 Feed Connector shall be 12 inches (305 mm) tall, 16 inches (406 mm) wide and 24.2 inches (615 mm) long.
10. The nominal storage volume of the Recharger® 150XLHD chamber shall be 2.650 ft^3 / ft (0.246 m^3 / m) - without stone. The nominal storage volume of a single Recharger 150XLRHD Stand Alone unit shall be 29.15 ft^3 (0.83 m^3) - without stone. The nominal storage volume of a joined Recharger® 150XLIHD Intermediate unit shall be 27.16 ft^3 (0.77 m^3) - without stone. The nominal storage volume of the length adjustment amount per run shall be 1.99 ft^3 (0.18 m^3) - without stone.
11. The nominal storage volume of the HVLV® FC-24 Feed Connector shall be 0.913 ft^3 / ft (0.085 m^3 / m) - without stone.
12. The Recharger® 150XLHD chamber shall have thirty discharge holes bored into the sidewalls of the unit's core to promote lateral conveyance of water.
13. The Recharger® 150XLHD chamber shall have 20 corrugations.
14. The end wall of the chamber, when present, shall be an integral part of the continuously formed unit. Separate end plates cannot be used with this unit.
15. The Recharger® 150XLRHD Stand Alone unit must be formed as a whole chamber having two fully formed integral end walls and having no separate end plates or separate end walls.
16. The Recharger® 150XLSHD Starter unit must be formed as a whole chamber having one fully formed integral end wall and one partially formed integral end wall with a lower transfer opening of 10 inches (254 mm) high x 20.5 inches (521 mm) wide.
17. The Recharger® 150XLIHD Intermediate unit must be formed as a whole chamber having one fully open end wall and one partially formed integral end wall with a lower transfer opening of 10 inches (254 mm) high x 20.5 inches (521 mm) wide.
18. The Recharger® 150XLEHD End unit must be formed as a whole chamber having one fully formed integral end wall and one fully open end wall and having no separate end plates or end walls.
19. The HVLV® FC-24 Feed Connector must be formed as a whole chamber having two open end walls and having no separate end plates or separate end walls. The unit shall fit into the side portals of the Recharger® 150XLHD and act as cross feed connections.
20. Chambers must have horizontal stiffening flex reduction steps between the ribs.
21. The chamber shall have a raised integral cap at the top of the arch in the center of each unit to be used as an optional inspection port or clean-out.
22. The units may be trimmed to custom lengths by cutting back to any corrugation on the large rib end.
23. The chamber shall be manufactured in an ISO 9001:2015 certified facility.
24. The chamber shall be designed and manufactured to meet the material and structural requirements of IAPMO PS 63-2019, including resistance to AASHTO H-10 and H-20 highway live loads, when installed in accordance with CULTEC's installation instructions.
25. The chamber shall be designed and manufactured in accordance with the specifications of NSAI Irish Agrement Board Certificate for Cultec Attenuation and Infiltration.
26. Maximum allowable cover over the top of the chamber shall be 12' (3.66 m).
27. The chamber shall be designed to withstand traffic loads when installed according to CULTEC's recommended installation instructions.